

Wet Slip Resistance Test Certificate


Thursday February 22nd, 2024

Supplier:	Floor Distributors Pty Ltd (719 The Horsley Drive, SMITHFIELD, NSW 2164, Australia).
Sample ID:	166978 (Sampling Conducted by Floor Distributors Pty Ltd)
Sample Description:	Viva Luxury Vinyl Plank
Colour:	Timber Look
Number of Specimens:	5 off, size 228 x 320 mm
Sample Preparation:	Washed with water and pH neutral detergent, rinsed then dried.
Test conditions & Slope:	Unfixed, N/A.
Test direction:	Test conducted parallel with grain of timber.
Air temperature:	21°C
Date Tested:	7 February 2024 (Tested through laboratories - NATA Accreditation 2735)
Test Method:	AS/NZS 4586-2013 Appendix A "Slip resistance classification of new pedestrian surface materials – Wet Pendulum Test Method" using a Four S slider (Slider 96)
Test Equipment:	Munro Stanley Pendulum Skid Resistance Tester Serial Number: 0320, Calibrated 03/05/2022.
Slider Rubber:	Slider 96 Batch No: #20 Prepared on P400 & 3 µm lapping film.

Test Results:

Specimen Number	1	2	3	4	5
Mean British Pendulum Number (BPN)	40	38	40	40	41
Slip Resistance Value (SRV)	40				
Classification	P3				

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip resistance be checked. Where alternatives are permitted by the standard, the choice of rubber slider used may also influence the test results obtained.

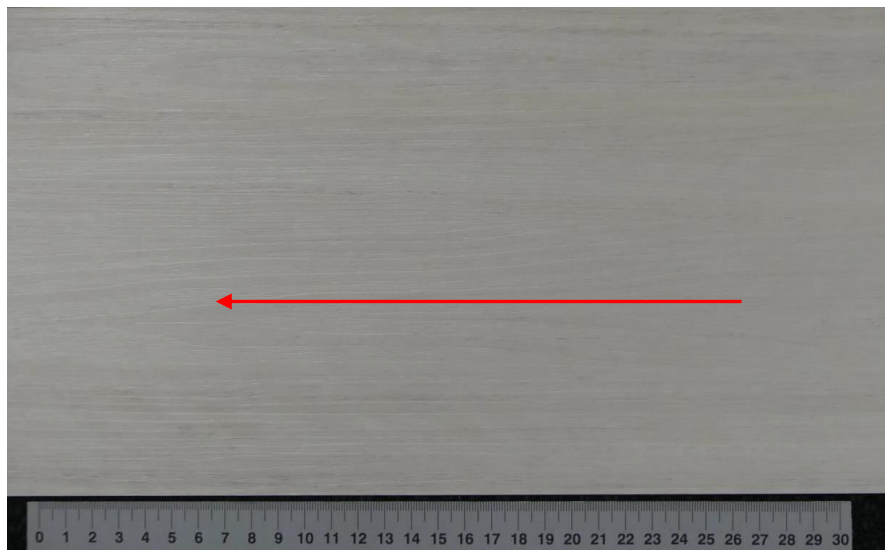

166978 - Arrow indicates direction of testing



Dr. Vyt Garnys
 PhD, BSc(Hons) AIMM, ARACI, ISIAQ
 ACA, AIRAH, FMA
 Managing Director and Principal Consultant



Travis Hale
 BSc (Biotechnology)
 Senior Consultant



Dr. Tuan Duong
 PhD, BEng (Chemical)
 Senior Consultant

P24020011